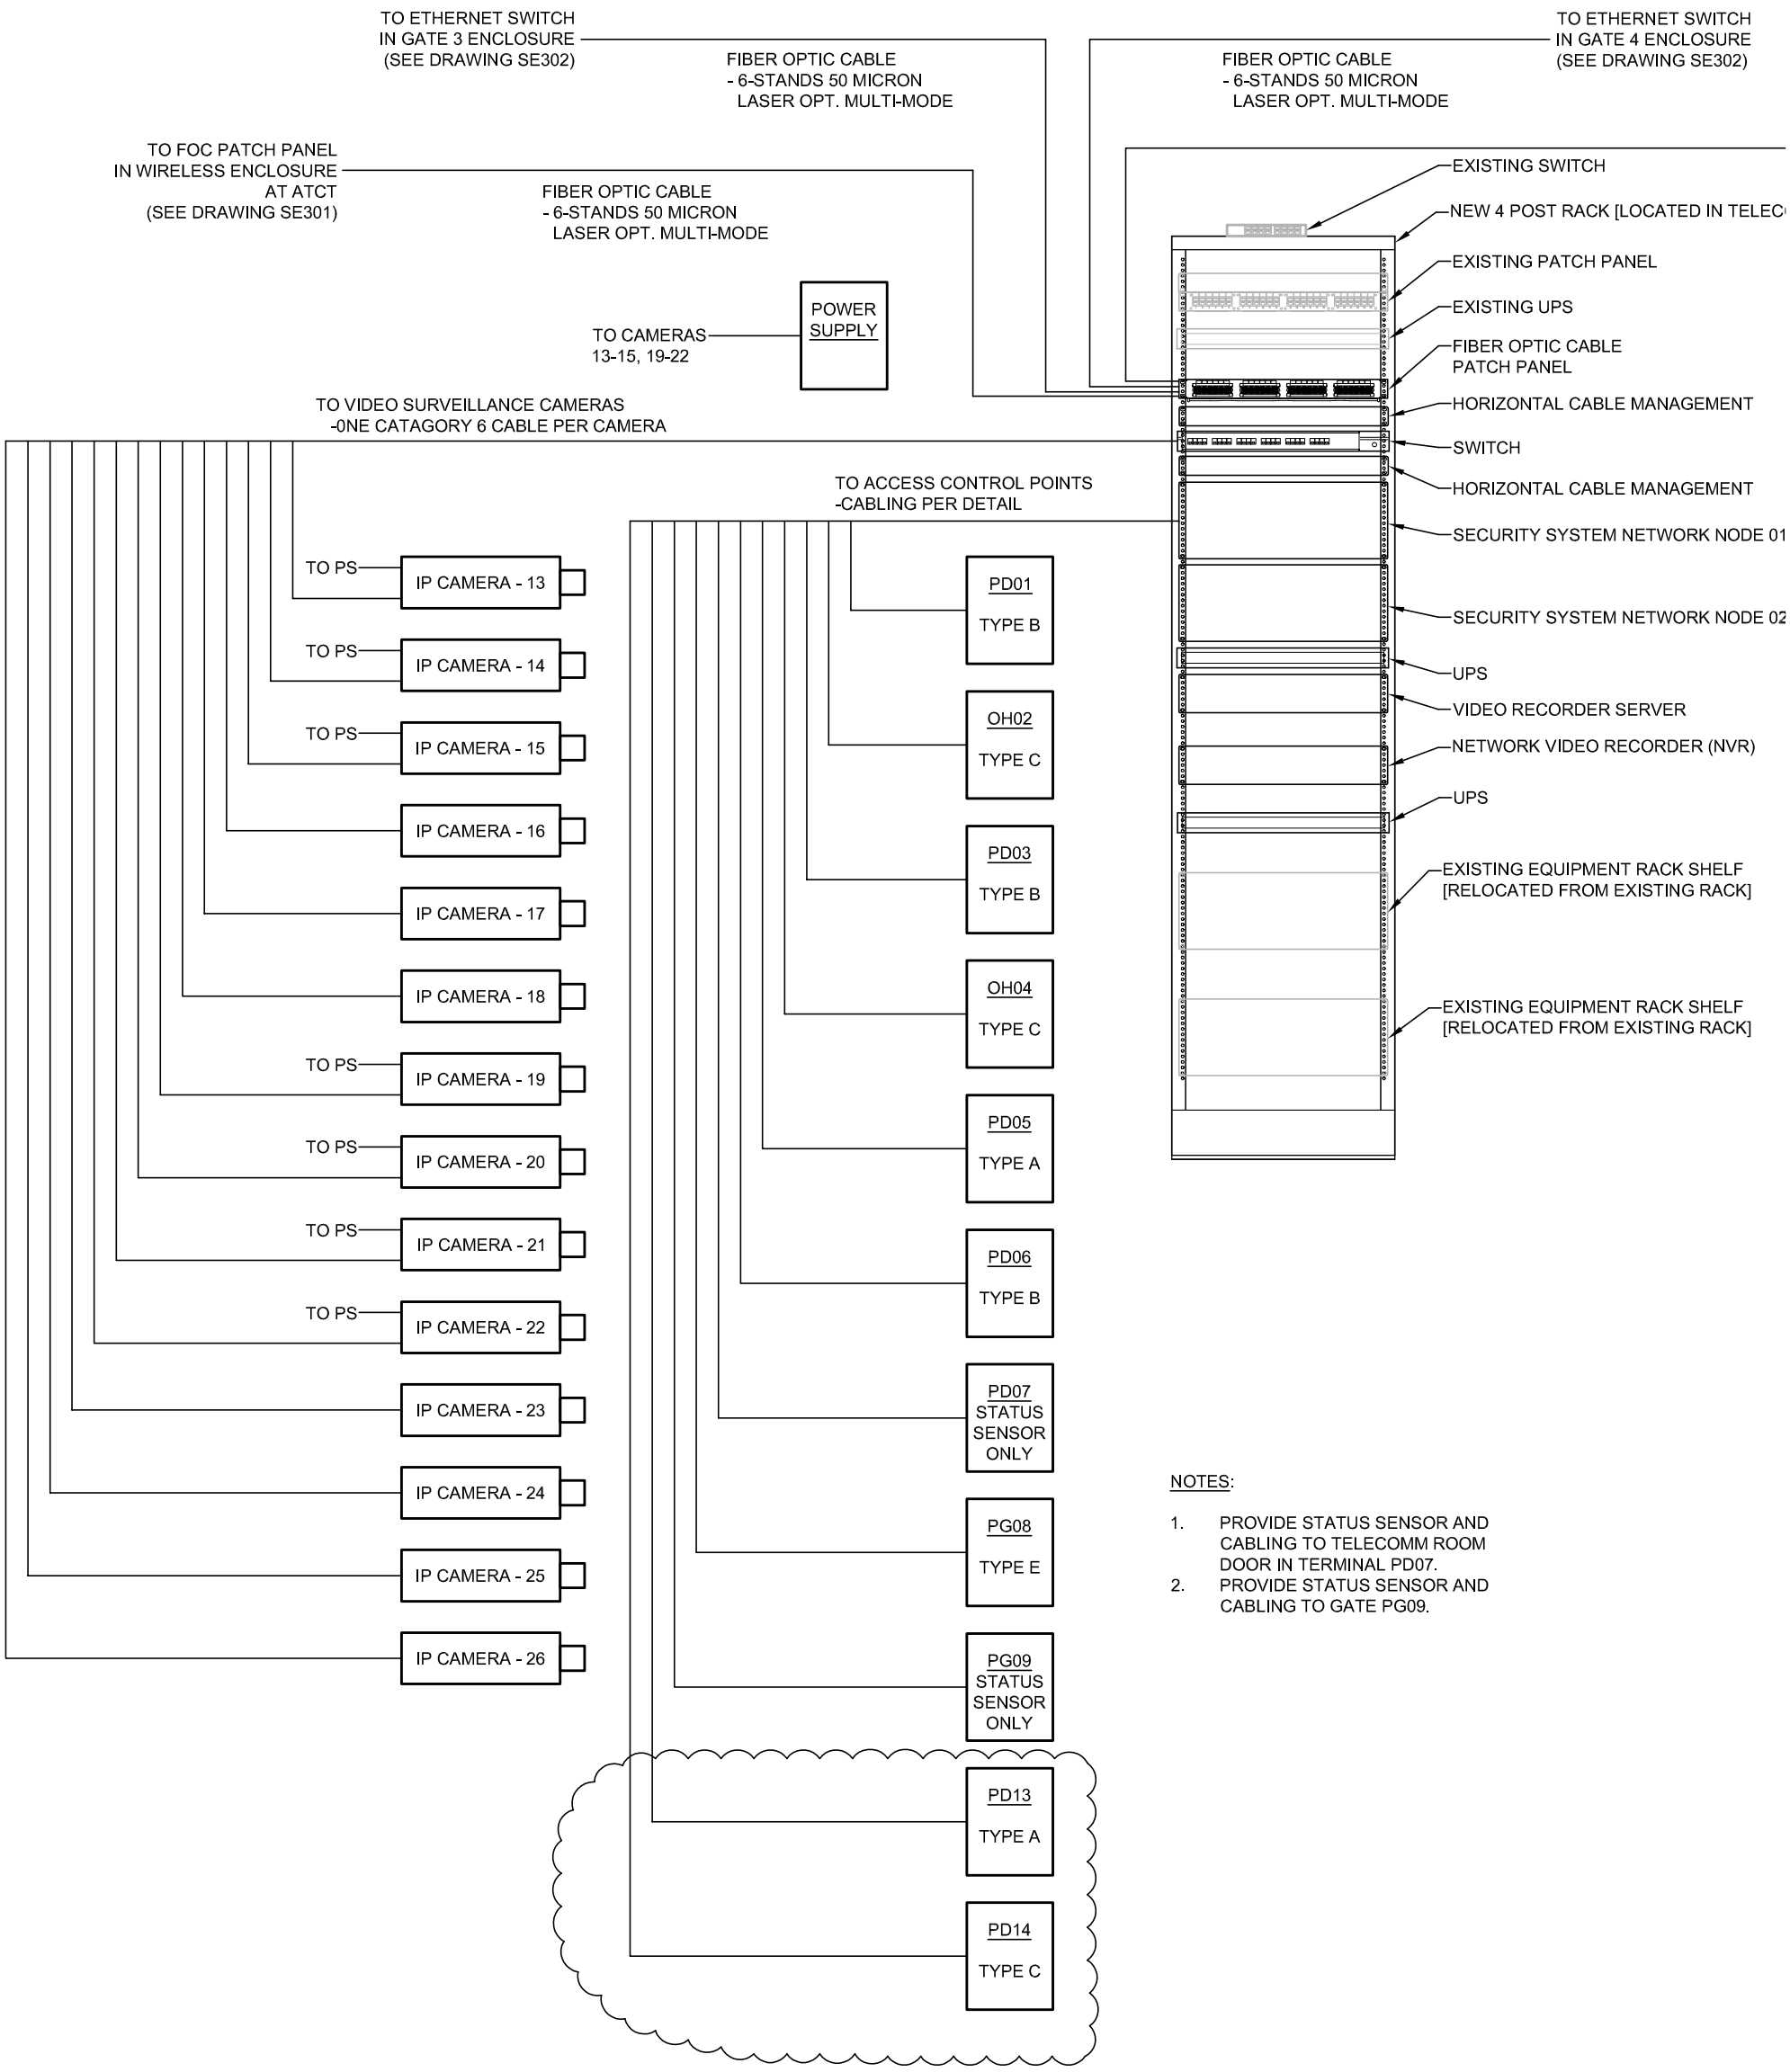

NOTES:

1. PROVIDE STATUS SENSOR AND CABLING TO TELECOMM ROOM DOOR IN TERMINAL PD07.
2. PROVIDE STATUS SENSOR AND CABLING TO GATE PG09.

1 **SECUI**
NO SCALE